

DD.S. 1/15
25/03/2026

R. 1149/10

EP. 1. 4896
17/03/26



Ahmedabad Municipal Corporation

No. 827

HEALTH DEPARTMENT
SWM

Date :

Sanitary Convenience Certificate

A Certificate for Sanitary Convenience is issued to the Manager / Secretary / Organiser of the Talkies / ^{school} Theatre named Doom Castle International School . Upendra Shah Situated at Survey No. 598/7 Right turn to. Narkarba Cross Road for the period of 12 months / Days i. e. from 01/01/2025 to 31/12/2026

"Issued Subject to NOC from other Concerned Departments"

Copy to :- Sanitary Superintendent

1. The manager/Secretary of the Theater/Organiser .
2. The Commissioner of Police, Ahmedabad.

1/1
S.S.

Dy. Director (SWM)
SWM Health Officer (AMC)

Ahmedabad Municipal Corporation

Zone :



AHMEDABAD MUNICIPAL CORPORATION
MAHANAGAR SEVA SADAN
CENTRAL LABORATORY
(An ISO 9001: 2015 Accredited Laboratory)



Lic No QAC/R91/4650

Dudheshwar Water Works Compound, Dudheshwar, Ahmedabad-380 004, Gujarat, India
E-mail: centrallab@ahmedabadcity.gov.in, Phone No-(079) 25631105, 25630438.

March 27, 2026.

To,
The Principal,
Doon Castle International School,
Survey No 598/1, Right Turn to Makarba Cross Roads
Vrindavan Farms, Opposite YMCA Club, S.G. Highway, Ahmedabad.

Dear Sir,

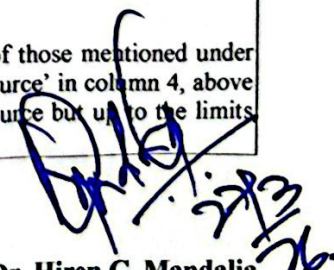
We have analyzed your water sample collected on Dt. 23-03-2026 for the following **Chemical and Bacteriological** parameters. The analysis report is as hereunder.

Sr. No.	Parameter	Requirement (Acceptable Limit)	Permissible Limit in the Absence of Alternate Source	Sample Value
		As per IS-10500-2012		
A. Organoleptic and Physical Parameters				
1	Colour, Hazen units, Max	5	15	0.1
2	pH value	6.5-8.5	No relaxation	7.34
3	Turbidity, NTU, Max	1	5	0.58
4	Total dissolved solids, mg/l, Max	500	2000	216
B. General Parameters				
1	Total hardness (as CaCO ₃), mg/l, Max	200	600	20
2	Calcium (as Ca), mg/l, Max	75	200	4
3	Magnesium (as Mg), mg/l, Max	30	100	2.44
4	Chloride (as Cl), mg/l, Max	250	1000	65
5	Sulphate (as SO ₄) mg/l, Max	200	400	10.4
6	Total alkalinity (as CaCO ₃), mg/l, Max	200	600	70
7	Free residual chlorine, mg/l, Min	0.2	1.0	Nil
C. Bacteriological Quality of Drinking Water				
1	Total Coliform bacteria, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detectable
2	E. coli, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detectable

Remarks:

- The Central Laboratory, AMC, has collected the sample.
- The result contained in this report relate only to the sample material tested.
- The report is not being reproduce wholly or in part and cannot be used as evidence in the court of law and should not be used in any advertising media without our special permission in writing.

NOTE — It is recommended that the acceptable limit is to be implemented. Values in excess of those mentioned under 'acceptable' render the water not suitable, but still 'permissible limit in the absence of alternate source' in column 4, above which the sources will have to be rejected. May be tolerated in the absence of an alternative source but up to the limits indicated.


Dr. Hiren C. Mandalia
Scientist In-Charge